


Environmental Certification Scheme

Carpet Name: **NET EFFECT B602**

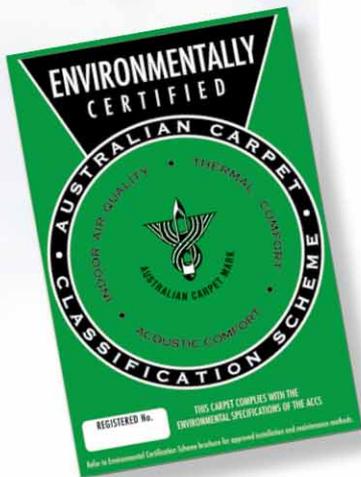

Licensee: **INTERFACE**
Licence Number: **1016**
Label Number: **13159**

Certification Approved: **1/12/2020**

Level: **4**

ACCS Contract Grading: **CEHD 4***
ACCS Residential Grading: **NONE**
Suitable for Stairs: **Yes**

Date Printed: **1/12/2020**

Allan Firth



Allan Firth
Secretary ACCS



Administered by the Carpet Institute of Australia Limited ABN 11 006 829 303
PO Box 7172, St Kilda Road, Melbourne Victoria 8004 Tel: (03) 9804 5559 • Fax: (03) 9804 5560
Email: info@carpetoz.com.au • www.carpetinstitute.com.au

This certificate remains the property of the Carpet Institute of Australia Limited.

Carpet Details:**Company: INTERFACE****Label No: 13159****Licence No: 1016****Office No: 5740****Names:**

NET EFFECT B602

Details:

Awarded Res Grade: NONE
 Awarded Con Grade: CEHD 4*
 Registered On: 16/09/2013
 Active: Yes
 Date In-Active:
 Manufacture Method: Tufted
 Twist Set: N/A
 Dyeing Method: Melt Dyed
 #Colours/Designs: 8
 Backing Type: Latex
 Felted: N/A
 Spinning System: BCF
 Insect Resist Agent: N/A
 Filament: 21.3
 Master Product:

Test Results:

Pile Mass g/m² (oz/yd²): 882 (26.0)
 SPM g/m² (oz/yd²): 662.8 (19.6)
 Stated Pile Height (mm): 4.0
 Minimum Pile Height (mm): 0.0
 Maximum Pile Height (mm): 0.0
 Dynamic Loading Loss (%): 0.0
 Static Loading Loss (%): 0.0
 Tex (g/1000m): 300
 Measured Pile Thickness (mm): 5.7
 Machine Gauge (Tufts/dm): 39.4
 Meas Tufts Perp to Selvedge: 40.5
 Meas Tufts Para to Selvedge: 48.8
 Treated For Soiling Resistance: Yes
 Soil Resist Inhibitor: Yes
 Stain Resist Inhibitor: No

Hexapod Scores:

	Texture		Colour		Thickness	
	WA		WA		(mm)	(%)
1500:	4.0	0.0	4.0	0.0	0.3	5.3
8000:	4.0	0.0	3.5	0.0	0.8	14.0

Quality Assurance Test:

Cut Pile (%): 0
 Loop Pile (%): 100
 Panel Assessment Contract: 11
 Panel Assessment Residential: 11
 Suitable For Stairs: Yes
 Tile: Yes SheetGoods: No
 Fibre Signature: NBA:100

ACCS Test:

	Con	Res	Max
SPM/PH Ratio:	16	16	16
Volume Density:	15.4	15.4	20
Tuft Density:	9	9	9
Dyn Load:	3.9	3.9	5
Stat Load:	4.1	4.1	5
Soiling Prop:	13	13	16
Abrasion Res:	10	10	10
Sub Total:	71.4	71.4	81
Panel Assess:	11	11	19
Total:	82.4	82.4	100
Calc Residential Grade:	REHD2		6*
Calc Contract Grade:	CHD		3*

Calculations

Pile Height(mm): 5.7
 Tuft Density(per dm²): 1976.4
 GSPM(g/m²): 415.0
 GSPM (abrasive) (g/m²): 275.0
 Soiling Propensity: 12.0 +1.0

OAF Values

OAF: 4.2
 Calc Density (+-5%): 0.11 0.116 0.12
 Base Fibre: NYLON
 Benchmarks:
 RHD1 0 RHD2 3.5
 REHD1 3.5 REHD2 3.5

Environmental Classification:

ECS: Yes
 Level: 4

	Calc	B/M	P/F
Acoustic:	5.7	3	PASS
Thermal:	49	15	PASS
VOC:			
TVOC	50		

Notes:

16/9/13 (Nylon 6) Submitted by J Azar. 25/9/13 Panel awarded CHD(S) 3*. 17/2/14 Interim ECS 4 given. 26/2/14 Panel certified to ECS Level 4. 28/9/2020 NB Three colour engaged product, machine stitch rate is 26.4/100mm. SPM & Pile Thickness inc >5% tolerance. 30/9/2020 Needs Extractable Matter & Pill Test & different Related Product for VOC. Indicative grade: CEHD(S) 4* & ECS Level 4. 1/12/2020 Compliant Extractable Matter, Pill Test & Related Product for VOC provided. Confirmed grading CEHD(S) 4* & ECS Level 4.