


Environmental Certification Scheme

Carpet Name: PB 324

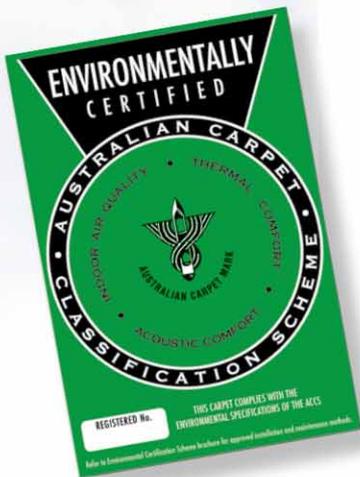

Licensee: INTERFACE
Licence Number: 1016
Label Number: 16020

Certification Approved: 24/02/2016

Level: 4

ACCS Contract Grading: CEHD 4*
ACCS Residential Grading: NONE
Suitable for Stairs: Yes

Date Printed: 25/11/2020

Allan Firth



Allan Firth
Secretary ACCS



Administered by the Carpet Institute of Australia Limited ABN 11 006 829 303
PO Box 7172, St Kilda Road, Melbourne Victoria 8004 Tel: (03) 9804 5559 • Fax: (03) 9804 5560
Email: info@carpetoz.com.au • www.carpetinstitute.com.au

This certificate remains the property of the Carpet Institute of Australia Limited.

Carpet Details:

Company: INTERFACE

Label No: 16020

Licence No: 1016

Office No: 6294

Names:

PB 324

Details:

Awarded Res Grade: NONE
 Awarded Con Grade: CEHD 4*
 Registered On: 19/02/2016
 Active: Yes
 Date In-Active:
 Manufacture Method: Tufted
 Twist Set: N/A
 Dyeing Method: Melt Dyed
 #Colours/Designs: 12/
 Backing Type: Other
 Felted: N/A
 Spinning System: BCF
 Insect Resist Agent: N/A
 Filament: 21.3
 Master Product:

Test Results:

Pile Mass g/m² (oz/yd²): 1085 (32.0)
 SPM g/m² (oz/yd²): 807.4 (23.8)
 Stated Pile Height (mm): 5.3
 Minimum Pile Height (mm): 0.0
 Maximum Pile Height (mm): 0.0
 Dynamic Loading Loss (%): 0.0
 Static Loading Loss (%): 0.0
 Tex (g/1000m): 300
 Measured Pile Thickness (mm): 5.3
 Machine Gauge (Tufts/dm): 39.4
 Meas Tufts Perp to Selvedge: 40.0
 Meas Tufts Para to Selvedge: 48.0
 Treated For Soiling Resistance: Yes
 Soil Resist Inhibitor: Yes
 Stain Resist Inhibitor: Yes

Hexapod Scores:

| | Texture | | Colour | | Thickness | |
|-------|---------|-----|--------|-----|-----------|------|
| | WA | | WA | | (mm) | (%) |
| 1500: | 4.0 | 0.0 | 4.0 | 0.0 | 0.2 | 3.8 |
| 8000: | 4.0 | 0.0 | 4.0 | 0.0 | 0.8 | 15.1 |

Quality Assurance Test:

Cut Pile (%): 50
 Loop Pile (%): 50
 Panel Assessment Contract: 13
 Panel Assessment Residential: 13
 Suitable For Stairs: Yes
 Tile: Yes SheetGoods: No
 Fibre Signature: NBA:100

ACCS Test:

| | Con | Res | Max |
|-------------------------|-------|-----|-----|
| SPM/PH Ratio: | 16 | 16 | 16 |
| Volume Density: | 13 | 13 | 20 |
| Tuft Density: | 9 | 9 | 9 |
| Dyn Load: | 3.5 | 3.5 | 5 |
| Stat Load: | 3.5 | 3.5 | 5 |
| Soiling Prop: | 14 | 14 | 16 |
| Abrasion Res: | 10 | 10 | 10 |
| Sub Total: | 69 | 69 | 81 |
| Panel Assess: | 13 | 13 | 19 |
| Total: | 82 | 82 | 100 |
| Calc Residential Grade: | REHD2 | | 6* |
| Calc Contract Grade: | CHD | | 3* |

Calculations

Pile Height(mm): 7.1
 Tuft Density(per dm²): 1920.0
 GSPM(g/m²): 460.0
 GSPM (abrasive) (g/m²): 275.0
 Soiling Propensity: 12.0 +2.0

OAF Values

OAF: 4.2
 Calc Density (+-5%): 0.14 0.152 0.16
 Base Fibre: NYLON
 Benchmarks:
 RHD1 0 RHD2 3.5
 REHD1 3.5 REHD2 3.5

Environmental Classification:

ECS: Yes
 Level: 4

| | Calc | B/M | P/F |
|-----------|------|-----|------|
| Acoustic: | 5.3 | 3 | PASS |
| Thermal: | 34.8 | 15 | PASS |
| VOC: | | | |
| TVOC | 470 | | |

Notes:

19/2/16 Nylon 6. Submitted by J Azar. 24/2/16 Panel awarded CHD(S) 3* and ECS Level 4. 20/11/2020 QA data entered. All within manufacturing tolerances. 25/11/2020 Panel awarded CEHD(S) 3* and ECS Level 4.