

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031

P.O Box 240. North Melbourne, Victoria 3051 Phone (03) 9371 2400 Fax (03) 9371 2499


TEST REPORT

Client : Interface Aus 34 Airds Roa Minto NSW 2			lssue Print	Number : • Date : Date : r Number :	15-00235 11/06/201 11/06/201 37060	5
Sample Description	Clients Ref : "Whole Earth WE Beige loop pile carpet tile Nominal Composition : 100% S Nominal Mass per Unit Area/Densit Nominal Thickness : 4mm	olution dyed Nyl	on 6 12 On a Glasb	ac Backing		
AS/ISO 9239.1-2003	Reaction to Fire Tests for Floorin Radiant Heat Source	gs. Determinati	on of the Bur	ning Behavio	our using a	
	Date of Sample Arrival 21/05/2015					
	Date Tested 10/06/2015					
	CHF Value	1	2	3	Mean	
	Length	4.6	4.8	4.5	4.6	kW/m²
	Width	5.7	-	-	-	kW/m²
	Smoke Value	1	2	3	Mean	
	Length	125	109	138	124	%.min
	Width	111	-	-	-	%.min
	Melting				Yes	
	Blistering					

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2001 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Each specimen was adhered to a substrate of 6mm thick fibre reinforced cement board using Roberts 656 adhesive and clamped prior to testing.

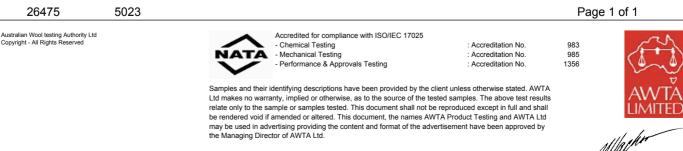



C

APPROVED SIGNATORY